



# Standard Director's Chair

Bleeding area   
Safe visible area 

Keep all important graphics inside the safe visible areas  
All text & strokes must be outlined  
Any pixel-based artwork must be a minimum of 100dpi


## Chair Back (Inside)

16.5in x 8.2in / 420mm x 210mm

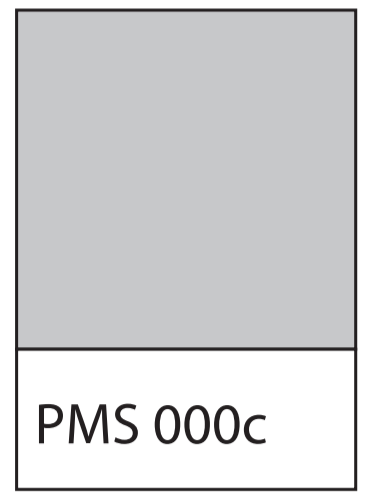

## Chair Back (Outside)

27.5in x 8.2in / 700mm x 210mm



## Chair Seat

23.6in x 16.9in / 600mm x 430mm

